

WIND DATA REPORT

Bourne Water District

December 2009 to November 2010

Prepared for

Massachusetts Clean Energy Center
55 Summer Street, 9th Floor
Boston, MA 02110

by

Dylan Chase
James F. Manwell
Utama Abdulwahid
Anthony F. Ellis

January 14, 2011

Report template version 1.7

Wind Energy Center
University of Massachusetts, Amherst
160 Governors Drive, Amherst, MA 01003
www.umass.edu/windenergy • (413) 545-4359 • rerl@ecs.umass.edu



NOTICE AND ACKNOWLEDGEMENTS

This report was prepared by the Wind Energy Center (WEC) at the University of Massachusetts, Amherst in the course of performing work sponsored by the Renewable Energy Trust (RET), as administered by the Massachusetts Clean Energy Center (MassCEC). The opinions expressed in this report do not necessarily reflect those of MTC or the Commonwealth of Massachusetts, and reference to any specific product, service, process, or method does not constitute an implied or expressed recommendation or endorsement of it.

Further, MassCEC, the Commonwealth of Massachusetts, and the Wind Energy Center make no warranties or representations, expressed or implied, as to the fitness for particular purpose or merchantability of any product, apparatus, or service, or the usefulness, completeness, or accuracy of any processes, methods or other information contained, described, disclosed, or referred to in this report. MassCEC, the Commonwealth of Massachusetts, and the Wind Energy Center make no representation that the use of any product, apparatus, process, method, or other information will not infringe privately owned rights and will assume no liability for any loss, injury, or damage directly or indirectly resulting from, or occurring in connection with, the use of information contained, described, disclosed, or referred to in this report.

TABLE OF CONTENTS

Notice and Acknowledgements	1
Table of Contents	2
Table of Figures	3
Executive Summary	4
SECTION 1 - Station Location.....	5
SECTION 2 - Instrumentation and Equipment	6
SECTION 3 - Data Summary	6
SECTION 4 - Long Term Estimate and Capacity Factor	9
SECTION 5 - Graphs	10
Wind Speed Time Series	12
Wind Speed Distributions.....	12
Monthly Average Wind Speeds	13
Diurnal Average Wind Speeds.....	13
Turbulence Intensities	13
Wind Roses	14
SECTION 6 - Significant Meteorological Events	14
SECTION 7 - Data Collection and Maintenance.....	15
SECTION 8 - Data Recovery and Validation	15
Test Definitions	15
Sensor Statistics	16
APPENDIX A - Sensor Performance Report	18
Test Definitions.....	18
Sensor Statistics	19
APPENDIX B - Plot Data	20
Wind Speed Distribution Data.....	20
Monthly Average Wind Speed Data	20
Diurnal Average Wind Speed Data.....	21
Wind Rose Data	22

TABLE OF FIGURES

Figure 1 – Site Location	5
Figure 2 - Wind Speed Time Series, December 1, 2009 – November 30, 2010	12
Figure 3 - Wind Speed Distribution, December 1, 2009 – November 30, 2010	12
Figure 4 - Monthly Average Wind Speed, December 1, 2009 – November 30, 2010.....	13
Figure 5 - Diurnal Average Wind Speeds, December 1, 2009 – November 30, 2010.....	13
Figure 6 - Turbulence Intensity vs. Wind Speed, December 1, 2009 – November 30, 2010	13
Figure 7 - Wind Rose, December 1, 2009 – November 30, 2010	14

EXECUTIVE SUMMARY

All the work presented in this Wind Data Report including installation and decommissioning of the meteorological tower and instrumentation, and the data analysis and reporting was performed by the Wind Energy Center (WEC) at the University of Massachusetts, Amherst.

Wind monitoring equipment was installed at the Bourne Water District site on November 18th 2009. The base of the 50 meter meteorological tower was installed 24 meters above sea level. Anemometers were installed at heights of 38 and 50 meters (124.7 and 164.0 feet) above the tower base. Redundant anemometers and wind vanes were installed at both heights. A temperature sensor was installed near the base of the tower.

This report summarizes the wind data collected at the site for the one year period, between December 2009 and November 2010. The mean recorded wind speed was 5.37 m/s (12.01 mph*) at 50 meters, and the prevailing wind direction was from the southwest. The average wind shear component was 0.358 and the average turbulence intensity at 50 meters was 0.204.

The gross data recovery percentage (the actual percentage of expected data received) was 100.00% and the net data recovery percentage (the percentage of expected data which passed all of the quality assurance tests) was 99.211%.

Additional information about interpreting the data presented in this report can be found in the Fact Sheet, "Interpreting Your Wind Resource Data," produced by WEC and the Massachusetts Clean Energy Center (MassCEC). This document is found through the WEC website:

http://www.ceere.org/rerl/about_wind/RERL_Fact_Sheet_6_Wind_resource_interpretation.pdf

* 1 m/s = 2.237 mph.

SECTION 1 - Station Location

The site is located in a wooded area that can be reached by an access road. The site was cleared to erect the tower. The location of the tower is $41^{\circ}42'35.00$ N, $70^{\circ}35'44.10$ W and the base of the 50 meter tower is 24 meters above sea level. The approximate tower location is marked by the white box shown in Figure 1.

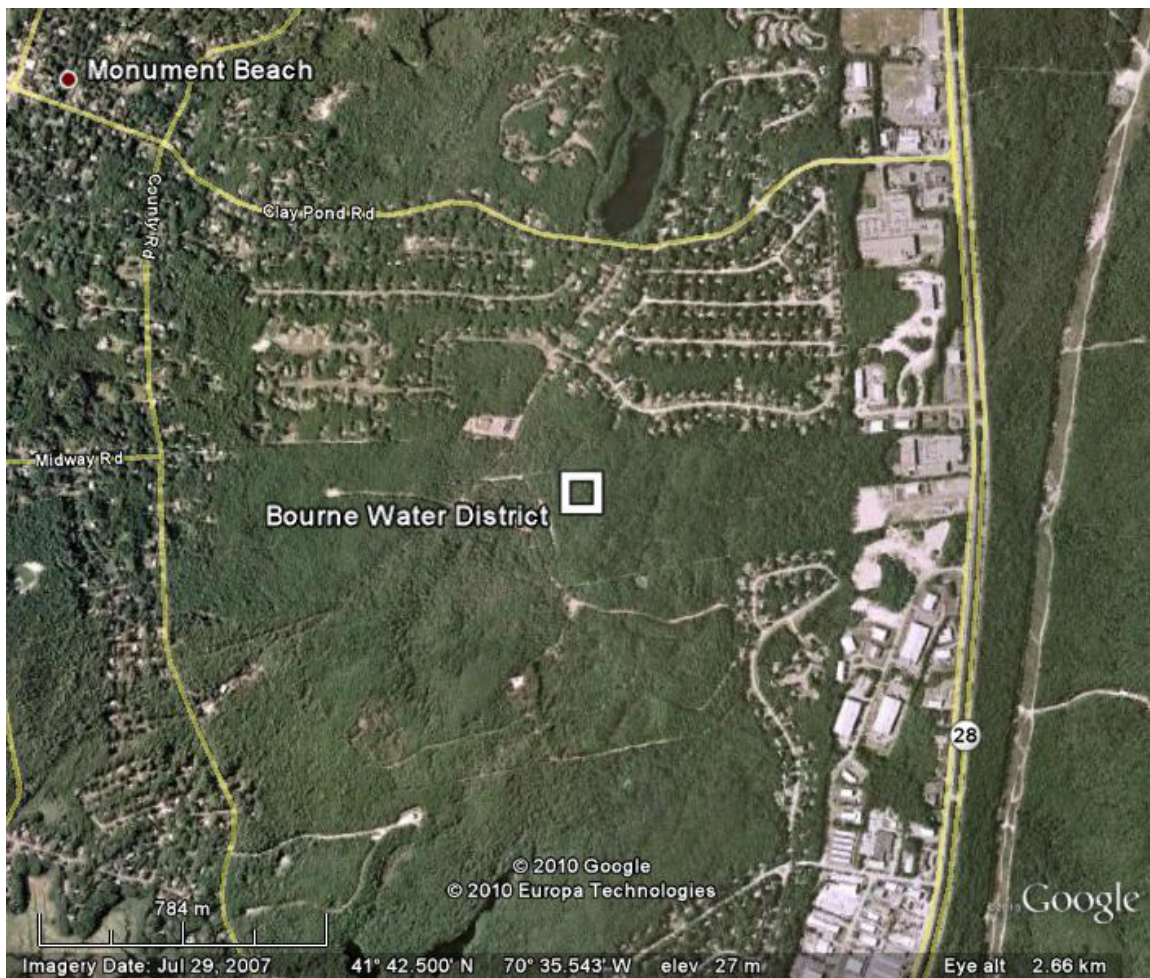


Figure 1 – Site Location

SECTION 2 - Instrumentation and Equipment

The wind monitoring equipment is mounted on a 50 m (164 ft) meteorological tower. The wind monitoring equipment comes from NRG systems and consists of the following items:

- NRG Symphonie data logger
- 1 – NRG#40C Anemometer, calibrated (Slope – 0.755 m/s, offset – 0.37 m/s) located at 50 m (164.0 ft).
- 3 – NRG #40C3 Anemometers, standard calibration (Slope – 0.765 m/s, Offset – 0.350 m/s). One anemometer is located at 50 m (164.0 ft), and two anemometers are located at 38 m (124.7 ft).
- 2 – NRG #200P Wind direction vanes. The vanes are located at 50 m (164.0 ft) and 38 m (124.7 ft).
- NRG 110S temperature Sensor located near the base of the tower.

SECTION 3 - Data Summary

A summary of the wind speeds and wind directions measured during the reporting period is included in Table 1. Table 1 includes the mean wind speeds measured at each measurement height, the maximum instantaneous wind speed measured at each measurement height and the prevailing wind direction measured at each measurement height. These values are provided for each month of the reporting period and for the whole reporting period.

Table 1. Wind Speed and Direction Data Summary

Date	Mean Wind Speed	Max Wind Speed	Prevailing Wind Direction	Mean Wind Speed	Max Wind Speed	Prevailing Wind Direction
Height Units	50 m [m/s]	50 m [m/s]	50 m [deg]	38 m [m/s]	38 m [m/s]	38 m [deg]
Dec 2009	6.14	17.29	NW	5.53	15.84	NW
Jan 2010	5.31	17.78	WNW	4.81	16.31	WNW
Feb 2010	5.48	17.14	WNW	5.02	16.03	WNW
Mar 2010	6.35	17.38	NNE	5.78	16.44	NNE
Apr 2010	4.92	14.39	SW	4.44	12.74	SW
May 2010	4.91	11.93	SE	4.50	10.71	SW
June 2010	4.67	11.95	SSW	4.26	11.21	SSW
July 2010	4.44	10.58	SW	4.05	9.74	SW
Aug 2010	4.88	15.58	SW	4.41	14.36	SW
Sept 2010	5.42	12.26	SW	4.89	11.6	SW
Oct 2010	6.044	13.92	W	5.45	12.77	W
Nov 2010	5.87	13.54	NNE	5.29	12.25	NNE
Dec 2009- Nov 2010	5.369	17.78	SW	4.867	16.44	SW

Wind data statistics in the table are reported when more than 90% of the data during the reporting period are valid. In cases when a larger amount of data are missing, the percent of the available data that are used to determine the data statistics is noted.

No measurement of wind speed or direction can be perfectly accurate. Wind speed measurement errors occur due to anemometer manufacturing variability, anemometer calibration errors, the response of anemometers to turbulence and vertical air flow and due to air flows caused by the anemometer mounting system. Every effort is made to reduce the sources of these errors. Nevertheless, the values reported in this report have an expected uncertainty of about $\pm 2\%$ or ± 0.2 m/s, whichever is greater. Wind direction measurement errors occur due to sensor measurement uncertainty, tower effects, boom alignment measurement errors and twisting of pipe sections during the raising of a pipe tower. Efforts are also made to reduce these errors, but the reported wind directions are estimated to have an uncertainty of ± 5 degrees.

A summary of the turbulence intensity and mean wind shear measured at each measurement height during the reporting period is included in Table 2. These values are

provided for each month of the reporting period and for the whole reporting period. Turbulence Intensity is calculated by dividing the standard deviation of the wind speed by the mean wind speed and is a measure of the gustiness of a wind resource. Lower turbulence results in lower mechanical loads on a wind turbine. Turbulence intensity varies with wind speed. The average turbulence intensity presented in Table 2 is the mean turbulence intensity when the wind speed at the highest measurement height is between 9.5 and 10.5 m/s.

Shear coefficients provide a measure of the change in wind speed with height. When data at multiple heights are available, shear coefficients, α , have been determined. They can be used in the following formula to estimate the average wind speed, $U(z)$, at height z , when the average wind speed, $U(z_r)$, at height z_r is known:

$$U(z) = U(z_r) \left(\frac{z}{z_r} \right)^\alpha$$

The change in wind speed with height is a very complicated relationship related to atmospheric conditions, wind speed, wind direction, time of day and time of year. This formula will not always provide the correct answer at any given site. Nevertheless the calculated shear coefficient, based on measurements at two heights, can be used to characterize the degree of increase in wind speed with height at a site.

The mean wind shear coefficient that is provided here is calculated based on the mean wind speeds in Table 1, where z_{high} and z_{low} are the heights of the higher and lower mean wind speeds used in the calculation and $U(z_{low})$ and $U(z_{high})$ are the mean wind speeds at the two heights.

$$\alpha = \log \left(\frac{U(z_{high})}{U(z_{low})} \right) / \log \left(\frac{z_{high}}{z_{low}} \right)$$

Table 2. Shear and Turbulence Intensity Data Summary

Date	Turbulence Intensity at 10 m/s	Turbulence Intensity at 10 m/s	Mean Wind Shear Coefficient, α
Height Units	50 m [-]	38 m [-]	Between 50 m and 38 m [-]
Dec 2009	0.202	0.228	0.38
Jan 2010	0.213	0.229	0.36
Feb 2010	0.206	0.226	0.32
Mar 2010	0.203	0.227	0.34
Apr 2010	0.215	0.232	0.38
May 2010	0.203	0.223	0.32
June 2010	0.205	0.223	0.34
July 2010	0.162	*	0.33
Aug 2010	0.198	0.222	0.37
Sept 2010	0.189	0.200	0.37
Oct 2010	0.205	0.225	0.38
Nov 2010	0.205	0.229	0.37
Dec 2009 - Nov 2010	0.204	0.226	0.358

* The maximum wind speed was lower than 10 m/s. Therefore turbulence intensity data is not available for 10 m/s and was not reported.

SECTION 4- Long Term Estimate and Capacity Factor

Wind speed varies year by year and the mean obtained over the measurement period may be less or more compared to what is seen over a longer time period. Therefore, the use of the long term mean at the site is preferred when projecting the performance of a wind turbine. The long term mean at a site may be estimated by using the Measure-Correlate-Predict (MCP) method.

The MCP method correlates wind speed measurements at the target site to a reference site which collects data over the same period of time and has been collecting data for a much longer period. Based on this correlation, the reference wind speed data is used to predict long term mean at the site.

Long term data from the Buzm3 buoy between January 15th, 1998 and August 31st, 2010 is used as reference in the case of the Bourne Water District site. Correlation between the two sites are obtained from concurrent data between November 19th, 2009 and August 31st, 2010. The long term mean at Bourne Water District at 50 m is estimated to be 5.38 m/s with an uncertainty of 4.4% for the MCP process. This estimate may also be used to calculate the long term mean at different heights by using the mean wind shear at site and the equation described in the previous section. The long term mean wind speed at 70 m height is estimated at 6.06 m/s.

The capacity factor of a wind turbine at a given site depends on the hub height, wind speed distribution at the hub height, the wind turbine power curve and any assumptions about down time and losses due to wake effects from upwind wind turbines, etc. If the hub height wind speed is estimated from data at lower heights, then the capacity factor will also depend on the estimated wind shear and the wind speeds measured at lower heights. No simple estimate of capacity factor at a site could take all of these effects and choices into account. Nevertheless, an estimate of the capacity factor of a wind turbine at this site is provided here to help the reader understand the order of magnitude of the wind resource at this site.

The estimates assume a GE 1.5 sl turbine with a hub height of 80 m and the long term mean wind speed estimate at the highest measurement height and the mean wind shear at the site, in order to determine the mean hub height wind speed, in this case 6.36 m/s. The wind speed probability distribution is assumed to be given by a Rayleigh distribution. The average wind turbine power is then estimated from:

$$\overline{P_w} = \int_0^{\infty} P_w(U) p(U) dU$$

where $P_w(U)$ is the wind turbine power curve and $p(U)$ is the wind speed probability distribution. The capacity factor is then calculated from:

$$CF = \frac{\overline{P_w}}{P_{rated}}$$

where P_{rated} is the rated capacity of the turbine, i.e., 1500 kW. Based on this equation, the estimated capacity factor of a wind turbine at this site would be about 0.301.

SECTION 5- Graphs

This report contains several types of wind data graphs. Unless otherwise noted, each graph represents data from one calendar year (November, 2009 to December, 2010). The following graphs are included:

- Time Series – 10-minute average wind speeds are plotted against time. This graph includes all of the collected data.
- Wind Speed Distribution – A histogram plot giving the percentage of time that the wind is at a given wind speed.
- Monthly Average – A plot of the monthly average wind speed over a 12-month period. This graph shows the trends in the wind speed over the whole period of data collection.
- Diurnal – A plot of the average wind speed for each hour of the day.
- Turbulence Intensity – A plot of turbulence intensity as a function of wind speed. Turbulence Intensity is calculated as the standard deviation of the wind speed divided by the wind speed and is a measure of the gustiness of a wind resource. Lower turbulence results in lower mechanical loads on a wind turbine.
- Wind Rose – A plot, by compass direction showing the percentage of time that the wind comes from a given direction and the average wind speed in that direction.

With regards to the Bourne Water District site, the following observations are noted.

- Time Series, Figure 2: shows that the wind speed at the site seldom exceeds 15 m/s.
- Wind Speed Distribution, Figure 3: wind speeds are primarily between 3 and 7 m/s and the most common wind speed is between 4 and 5 m/s. The wind speed distribution is slightly skewed towards higher wind speeds.
- Monthly Average, Figure 4: shows that March and December had the highest monthly average wind speed, while July had the lowest monthly average wind speed.
- Diurnal, Figure 5: shows that diurnal average wind speed was higher during day time hours than at night time hours. The diurnal average increases through the day, reaching a maximum at 2 pm EST.
- Turbulence Intensity, Figure 6: we can see the turbulence numbers roughly cluster between 0.1 and 0.3 for most wind speeds.
- Wind Rose, Figure 7: shows that the prevailing wind direction at this site for the year is from the southwest direction. The wind also comes from the south southwest direction, the west northwest direction and the northwest directions a

significant portion of the time. The highest average wind speeds came from the north northeast direction.

Data for the wind speed histograms, monthly and diurnal average plots, and wind roses are included in APPENDIX B.

Wind Speed Time Series

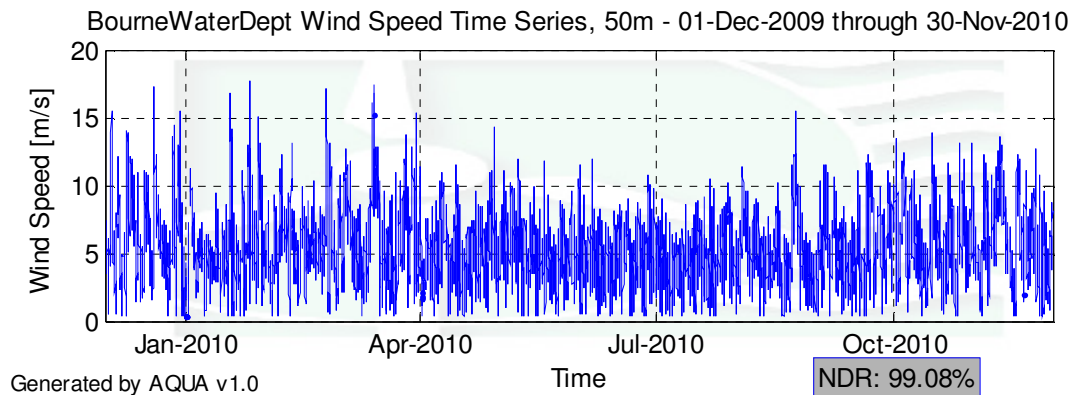


Figure 2 - Wind Speed Time Series, December 1, 2009 – November 30, 2010

Wind Speed Distributions

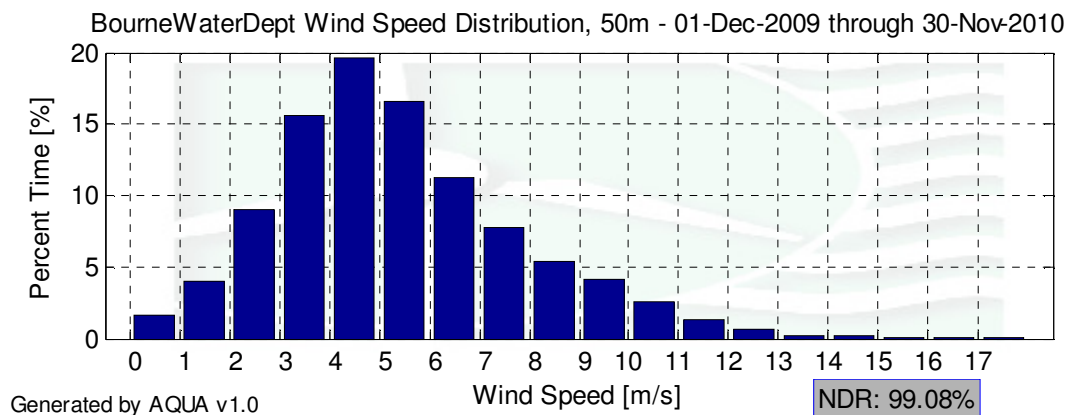


Figure 3 - Wind Speed Distribution, December 1, 2009 – November 30, 2010

Monthly Average Wind Speeds

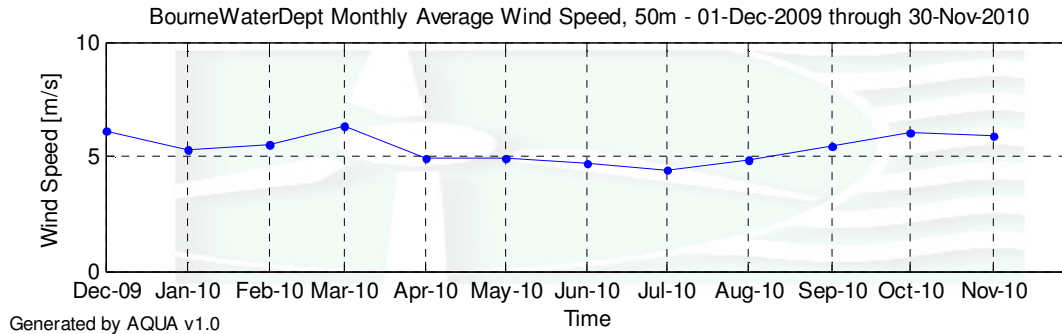


Figure 4 - Monthly Average Wind Speed, December 1, 2009 – November 30, 2010

Diurnal Average Wind Speeds

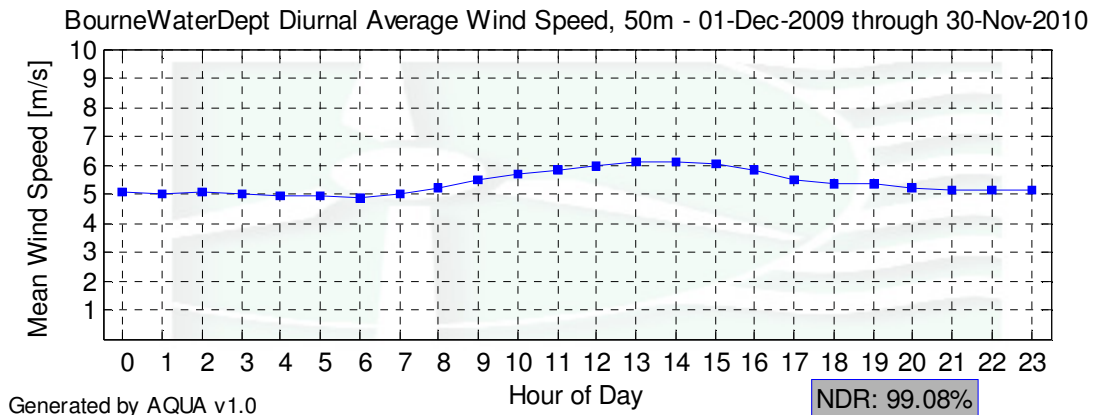


Figure 5 - Diurnal Average Wind Speeds, December 1, 2009 – November 30, 2010

Turbulence Intensities


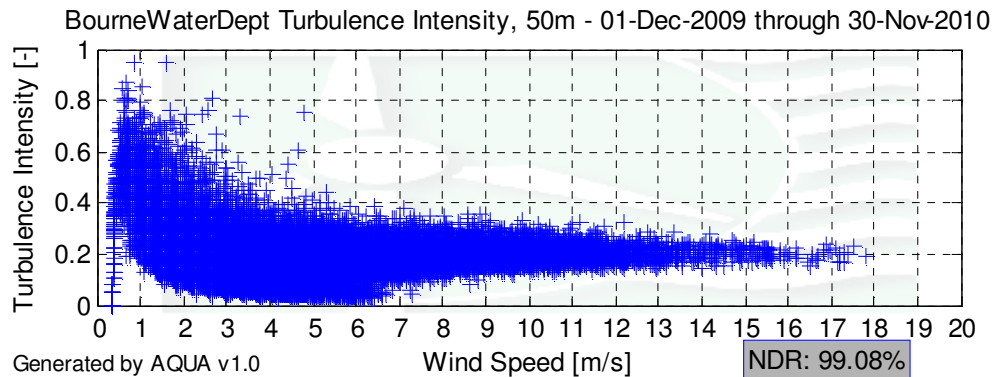


Figure 6 - Turbulence Intensity vs. Wind Speed, December 1, 2009 – November 30, 2010

Wind Roses

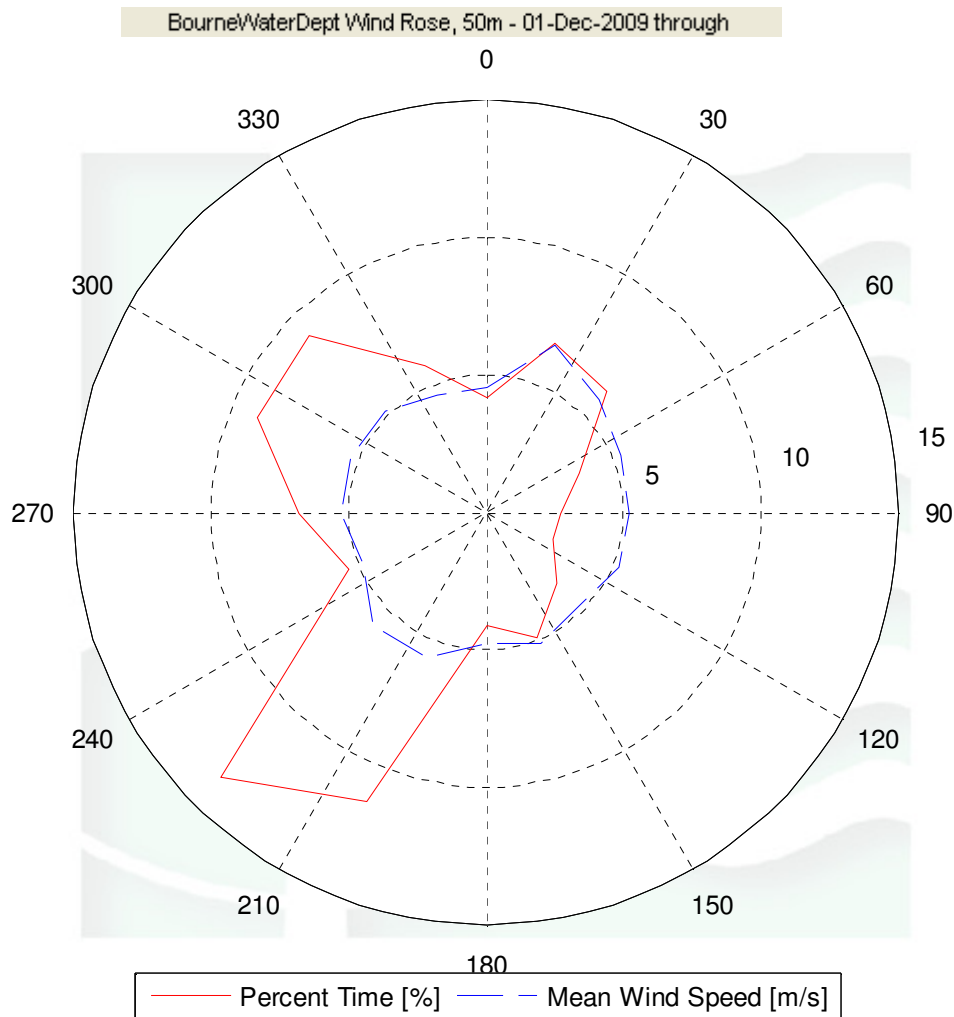

Generated by AQUA v1.0

NDR: 99.01%

Figure 7 - Wind Rose, December 1, 2009 – November 30, 2010

SECTION 6 - Significant Meteorological Events

There were no extreme meteorological events during this data collection period. The highest recorded wind speed was 17.78 m/s (39.77 mph) at 50 meters.

SECTION 7 - Data Collection and Maintenance

All sensors and equipment functioned properly throughout the monitoring period. No maintenance was performed during this year.

SECTION 8 - Data Recovery and Validation

All raw wind data are subjected to a series of tests and filters to weed out data that are faulty or corrupted. Definitions of these quality assurance (QA) controls are given below under Test Definitions and Sensor Statistics. These control filters were designed to automate the quality control process and used many of the previous hand-worked data sets made at UMass to affect a suitable emulation. The gross percentage of data recovered (ratio of the number of raw data points received to data points expected) and net percentage (ratio of raw data points which passed all QA control tests to data points expected) are shown below. [Statistics over whole period of data collection].

Gross Data Recovered [%]	100.00
Net Data Recovered [%]	99.211

Test Definitions

All raw data were subjected to a series of validation tests, as described below. The sensors tested and the parameters specific to each sensor are given in the Sensor Performance Report which is included in APPENDIX A. Data which were flagged as invalid were not included in the statistics presented in this report.

MinMax Test: All sensors are expected to report data values within a range specified by the sensor and logger manufacturers. If a value falls outside this range, it is flagged as invalid. A data value from the sensor listed in Test Field 1 (TF1) is flagged if it is less than Factor 1 (F1) or greater than Factor 2. This test has been applied to the following sensors (as applicable): wind speed, wind speed standard deviation, wind direction, temperature, and solar insolation.

$$F1 > TF1 > F2$$

MinMaxT Test: This is a MinMax test for wind direction standard deviation with different ranges applied for high and low wind speeds. A wind direction standard deviation data value (TF1) is flagged either if it is less than Factor 1, if the wind speed (TF2) is less than Factor 4 and the wind direction standard deviation is greater than Factor 2, or if the wind speed is greater than or equal to Factor 4 and the wind direction standard deviation is greater than Factor 3.

$$\begin{aligned}
 &(\text{TF1} < \text{F1}) \\
 &\text{or } (\text{TF2} < \text{F4} \text{ and } \text{TF1} > \text{F2}) \\
 &\text{or } (\text{TF2} \geq \text{F4} \text{ and } \text{TF1} > \text{F3})
 \end{aligned}$$

Icing Test: An icing event occurs when ice collects on a sensor and degrades its performance. Icing events are characterized by the simultaneous measurements of near-zero standard deviation of wind direction, non-zero wind speed, and near- or below-freezing temperatures. Wind speed, wind speed standard deviation, wind direction, and wind direction standard deviation data values are flagged if the wind direction standard deviation (CF1) is less than or equal to Factor 1 (F1), the wind speed (TF1) is greater than Factor 2 (F2), and the temperature (CF2) is less than Factor 3 (F3). To exit an icing event, the wind direction standard deviation must be greater than Factor 4.

$$\text{CF1} \leq \text{F1} \text{ and } \text{TF1} > \text{F2} \text{ and } \text{CF2} < \text{F3}$$

CompareSensors Test: Where primary and redundant sensors are used, it is possible to determine when one of the sensors is not performing properly. For anemometers, poor performance is characterized by low data values. Therefore, if one sensor of the pair reports values significantly below the other, the low values are flagged. At low wind speeds (Test Fields 1 and 2 less than or equal to Factor 3) wind speed data are flagged if the absolute difference between the two wind speeds is greater than Factor 1. At high wind speeds (Test Fields 1 or 2 greater than Factor 3) wind speed data are flagged if the absolute value of the ratio of the two wind speeds is greater is greater than Factor 2.

$$\begin{aligned}
 &[\text{TF1} \leq \text{F3} \text{ and } \text{TF2} \leq \text{F3} \text{ and } \text{abs}(\text{TF1} - \text{TF2}) > \text{F1}] \\
 &\text{or } [(\text{TF1} > \text{F3} \text{ or } \text{TF2} > \text{F3}) \text{ and } (\text{abs}(1 - \text{TF1} / \text{TF2}) > \text{F2} \text{ or } \text{abs}(1 - \text{TF2} / \text{TF1}) > \text{F2})]
 \end{aligned}$$

Sensor Statistics

A summary of the results of the data collection and filtering are given in the Sensor Performance Report which is included in APPENDIX A. The following categories of information, tabulated for each sensor, are included in that report.

Expected Data Points: the total number of sample intervals between the start and end dates (inclusive).

Actual Data Points: the total number of data points recorded between the start and end dates.

% Data Recovered: the ratio of actual and expected data points (this is the *gross data recovered percentage*).

Hours Out of Range: total number of hours for which data were flagged according to MinMax and MinMaxT tests. These tests flag data which fall outside of an expected range.

Hours of Icing: total number of hours for which data were flagged according to Icing tests. This test uses the standard deviation of wind direction, air temperature, and wind speed to determine when sensor icing has occurred.

Hours of Fault: total number of hours for which data were flagged according to CompareSensors tests. These tests compare two sensors (e.g. primary and redundant anemometers installed at the same height) and flag data points where one sensor differs significantly from the other.

% Data Good: the filter results are subtracted from the gross data recovery percentage to yield the *net data recovered percentage*.

APPENDIX A - Sensor Performance Report

Test Definitions

Test Order	TestField1	TestField2	TestField3	CalcField1	CalcField2	TestType	Factor 1	Factor 2	Factor 3	Factor 4
1	Temp2C>T_val					MinMax	-30	60	0	0
2	Temp2C>T_min					MinMax	-30	60	0	0
3	Temp2C>T_max					MinMax	-30	60	0	0
4	Anem38aMs>WS_val					MinMax	0	90	0	0
5	Anem38aMs>WS_SD					MinMax	0	4	0	0
6	Anem38aMs>WS_min					MinMax	0	90	0	0
7	Anem38aMs>WS_max					MinMax	0	90	0	0
8	Anem38bMs>WS_val					MinMax	0	90	0	0
9	Anem38bMs>WS_SD					MinMax	0	4	0	0
10	Anem38bMs>WS_min					MinMax	0	90	0	0
11	Anem38bMs>WS_max					MinMax	0	90	0	0
12	Vane38Deg>WD_val					MinMax	0	359.9	0	0
13	Vane38Deg>WD_SD					MinMax	0	100	0	0
14	Anem50aMs>WS_val					MinMax	0	90	0	0
15	Anem50aMs>WS_SD					MinMax	0	4	0	0
16	Anem50aMs>WS_min					MinMax	0	90	0	0
17	Anem50aMs>WS_max					MinMax	0	90	0	0
18	Anem50bMs>WS_val					MinMax	0	90	0	0
19	Anem50bMs>WS_SD					MinMax	0	4	0	0
20	Anem50bMs>WS_min					MinMax	0	90	0	0
21	Anem50bMs>WS_max					MinMax	0	90	0	0
22	Vane50Deg>WD_val					MinMax	0	359.9	0	0
23	Vane50Deg>WD_SD					MinMax	0	100	0	0
24	Anem38aMs>WS_val	Anem38bMs>WS_val				Compare Sensors	1	0.25	3	0
25	Anem50aMs>WS_val	Anem50bMs>WS_val				Compare Sensors	1	0.25	3	0
26	Anem38aMs>WS_val	Anem38aMs>WS_SD	Vane38Deg>WD_val	Vane38Deg>WD_SD	Temp2C>T_val	Icing	0.5	1	2	4
27	Anem38bMs>WS_val	Anem38bMs>WS_SD	Vane38Deg>WD_val	Vane38Deg>WD_SD	Temp2C>T_val	Icing	0.5	1	2	4
28	Anem50aMs>WS_val	Anem50aMs>WS_SD	Vane50Deg>WD_val	Vane50Deg>WD_SD	Temp2C>T_val	Icing	0.5	1	2	4
29	Anem50bMs>WS_val	Anem50bMs>WS_SD	Vane50Deg>WD_val	Vane50Deg>WD_SD	Temp2C>T_val	Icing	0.5	1	2	4

Sensor Statistics

	Expected Data Points	Actual Data Points	% Data Recovered	Hours Out of Range	Hours of Icing	Hours of Fault	%Data Good
Temp2C	52560	52560	100	0.000	0.000	0.000	100.000
Anem38a	52560	52560	100	1.000	63.333	6.833	99.188
Anem38b	52560	52560	100	0.500	61.833	32.333	98.933
Vane38	52560	52560	100	2.000	63.833	0.000	99.248
Anem50a	52560	52560	100	1.000	81.000	0.667	99.056
Anem50b	52560	52560	100	0.833	77.833	6.167	99.032
Vane50	52560	52560	100	1.833	83.833	0.000	99.022
Total	367920	367920	100	7.167	431.667	46.000	99.211

APPENDIX B - Plot Data

Wind Speed Distribution Data

Bin Center Wind Speed [m/s]	Nov 2009 – Dec 2010 Percent Time [%]
0.5	1.59
1.5	4.02
2.5	9.06
3.5	15.56
4.5	19.68
5.5	16.52
6.5	11.26
7.5	7.73
8.5	5.37
9.5	4.10
10.5	2.56
11.5	1.36
12.5	0.63
13.5	0.25
14.5	0.15
15.5	0.10
16.5	0.03
17.5	0.02

Monthly Average Wind Speed Data

Month	Wind Speed at 50 m 10 min Average [m/s]
Dec-09	6.144
Jan-10	5.313
Feb-10	5.483
Mar-10	6.354
Apr-10	4.922
May-10	4.907
June-10	4.671
July-10	4.439
Aug-10	4.880
Sept-10	5.418
Oct-10	6.044
Dec-10	5.865

Diurnal Average Wind Speed Data

Hour of Day	Dec 2009– Dec 2010 Mean Wind Speed [m/s]
0	5.05
1	5.02
2	5.06
3	4.97
4	4.91
5	4.91
6	4.88
7	4.97
8	5.21
9	5.45
10	5.72
11	5.85
12	5.99
13	6.1
14	6.08
15	6.02
16	5.8
17	5.49
18	5.33
19	5.33
20	5.24
21	5.14
22	5.14
23	5.16

Wind Rose Data

Bin Center [deg]	Nov 2009 – Dec 2010	
	Percent Time [%]	Mean Wind Speed [m/s]
0	4.17	4.58
22.5	6.65	6.54
45	6.24	5.84
67.5	3.68	5.34
90	2.73	5.24
112.5	2.62	5.28
135	3.68	4.79
157.5	4.93	5.19
180	4.15	4.74
202.5	11.36	5.69
225	13.61	5.78
247.5	5.39	4.83
270	6.81	5.28
292.5	9.05	5.29
315	9.11	5.21
337.5	5.81	4.64